Panasonic®



此產品目錄以環保紙及墨印刷 Printed with environmental friendly ink on environmental paper

- Please read the Installation Instructions carefully before installing the unit, and the Operating Instructions before using it.
- \blacksquare Specifications are subject to change without prior notice.
- The contents of this catalogue are accurate as of October 2020
- \blacksquare Due to printing considerations, actual colours may vary slightly from those
- All graphics are provided solely for the purpose of illustrating a point.



Do not add or replace refrigerant other than the specified type. Manufacturer is not responsible for damage or deterioration in safety due to usage of other refrigerant.

Authorised Dealer

FreeMulti10/20



總代理 Sole Agent:

信興電工工程有限公司 SHUN HING ELECTRIC WORKS AND ENGINEERING CO., LTD.

辦公室: 香港九龍尖沙咀東部麼地道67號半島中心9樓909-912室 Room 909-912, 9/F, Peninsula Centre, 67 Mody Road, Tsim Sha Tsui East, Kowloon, Hong Kong.

電話 Tel: (852) 2861 2767 傳真 Fax: (852) 2865 6706

網址 Website: www.shew.com.hk 電郵 E-mail: shew@shunhinggroup.com



保養及維修 Maintenance and Repair Service 信興電器服務中心有限公司

SHUN HING ELECTRIC SERVICE CENTRE LTD.

辦公室: 香港新界葵涌勝耀街2號信興中心11樓


11/F, Shun Hing Centre, 2 Shing Yiu Street, Kwai Chung, New Territories, Hong Kong.

電話 Tel: (852) 2406 5666 傳真 Fax: (852) 2408 0316

網址 Website: www.shunhing-service.com

Panasonic

FREE MULTI AIR CONDITIONING SYSTEM

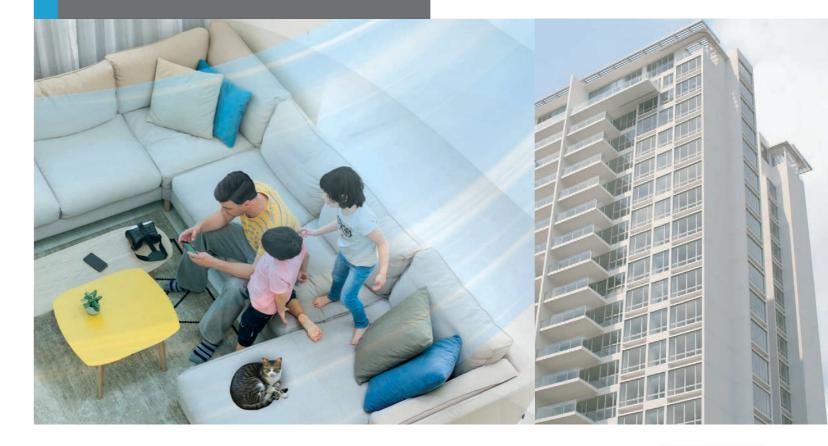








A Better Life, A Better World

QUALITY AIR FOR LIFE

Advantages of Panasonic Free Multi Air Conditioning System

Panasonic's free multi air conditioning systems are designed to enable flexible configuration and installation of indoor and outdoor units based on room conditions, location and installation convenience.

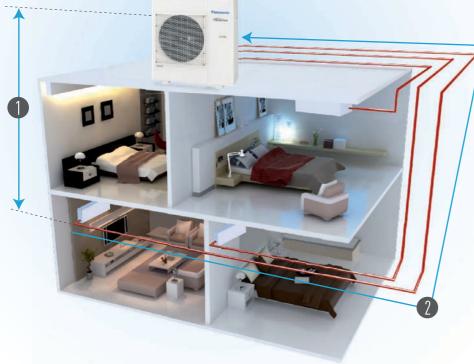

Flexible Installation

Free multi air conditioning system accommodates piping with a total length of up to 80 metres

- Maximum height up to 15 meters for indoor and outdoor unit.
- Piping can be extended up to a total length of 80 metres.*

* Applicable to CU-5F34PBF

Up to 5 indoor units of 3 types connect to 1 outdoor unit

Wall-mounted

nanoe™ for better indoor air quality




4-way 60x60 Cassette

The 4-way airflow for wide and even cooling More compact for more space



Low Static Ducted



Adaptor installation necessary for easier control via internet

CZ-TACG1 WIFI ADAPTOR (OPTIONAL)





Connection Diagram to Panasonic Comfort Cloud



Panasonic Cloud Server is designed, operated and managed by Panasonic.






nanoe™, technology with the benefits of hydoroxyl radicals

nanoe™ effectively inhibits bacteria and viruses. Regular air purifiers that use a filter are effective only against airborne bacteria and viruses, but nanoe™ is also effective against adhered bacteria and viruses.

Hydroxyl radicals inhibit the growth of pollutants such as bacteria, viruses, moulds, and odours, breaking them down and neutralising the unpleasant effects. This naturally occurring process has major benefits to improve indoor environments.

By creating hydroxyl radicals contained in tiny water particles, nanoe™ technology significantly boosts their effectiveness, increasing hydroxyl radicals lifetime from less than a second in nature, to more than 600 seconds – 10 minutes so that nanoe™ can spread over long distances.



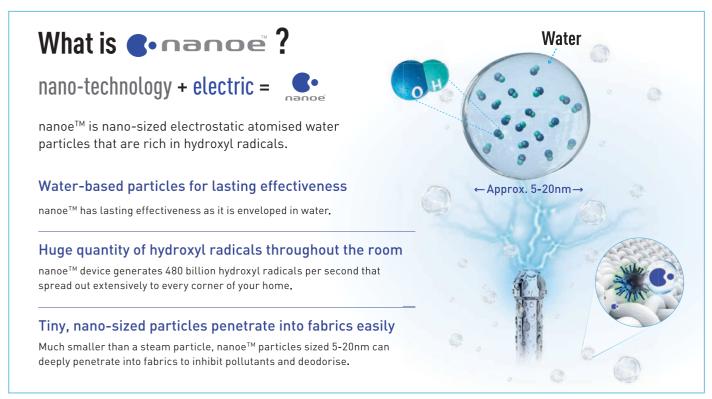



7 effects of nanoe™ technology with the benefits of hydroxyl radical technology

*Annotations for this information can be found on page 7











Allergens*4









nanoe™ inhibits not only airborne, but also adhered viruses

Panasonic's unique nanoe™ has an outstanding effect on a wide range of air pollutants. It is also highly effective against adhered bacteria and viruses.



nanoe™ is much smaller than steam and can deeply penetrate cloth fabrics to deodorise.





Does not exist

Exists

Xenotropic murine leukemia virus (MuLV)

Verify that the potential to inhibit highly resistant and unknown viruses

Four types of viruses were selected based on the virus clearance test guidelines, and comparison of nanoe™ exposure and non-exposure was carried out in testing according to GLP standards. It was confirmed that 99% of the virus infection value of the four types of virus was suppressed in six hours.

Charles River Biopharmaceutical Services GmbH (Germany)



Test period: September to November 2011

Test subjects: Xenotropic murine leukemia virus, Encephalomyocarditis virus, Pseudororabies virus Porcine parvovirus

Test method •Test box volume: 45L • Exposure time: 6 hours • Exposure distance: 15cm

Panasonic comfort cloud app. convenient centralised control













Advanced smartphone control for domestic range.

Control cooling/heat pump operation with Panasonic Comfort Cloud plus additional functions only available through the Cloud from wherever and whenever. One user can manage up to 200 units and also set up different user rights. Also, energy monitoring is possible allowing opportunity to learn how to reduce the operating cost even more.

Smart Control

In control of cooling comfort anytime, anywhere.

Connect & control operation.

- •20 units per location and up to 10 different locations
- •Transform multiple remote controls into one device

Manage multiple units at once.

- •Turn on all AC units at the same time or by group
- •Set weekly timers for multiple units to cater to your daily routines

Smart Comfort

Easily manage your comfort and air quality.

Adjust set temperature.

Set temperature by monitoring real time indoor and outdoor temperatures.

Pre-heat or cool.

Control your house or office comfort before you arrive!

Activate nanoe^{TM,} the advanced technology to deodorise and create healthier environment.

Smart Efficiency

More comfort with less wasted energy.

Energy usage analysis^{2]}.

Monitor energy consumption based on different temperature settings.

Energy usage comparison (day/week/month/year). Compare energy usage history of AC units for better budget planning.

Smart Assist

Be informed of breakdowns.

Error codes notification and identification^{3]}.

Launch the App to check error codes for effortless troubleshooting. Help technicians to easily identify the issues.

User's control right.

Register multiple users. Set administrator rights and assign users access.

1) nanoe™ is available in certain series. 2) Estimated energy consumption data accuracy depends on power supply quantity. 3) Contact trained technicians to perform

AEROWINGS

Cool air flows along the ceiling, not into your face, for comfort without feeling too cold.

Concentrated Airflow, Further and faster airflow across the room.



- independent flaps and motors.
- 1 2 Independent Motors Control the Sub-Flap and Bigger Outer Flap separately.
- 2 Sub-Flap Compresses and concentrates cool air.
- Bigger Outer Flap

Helps to deliver airflow further.





remote controller









Wall-mounted	Cooling capacity	Heating capacity	Sound pressure	Dimension / Net weight	Piping connections
Indoor unit (Wireless Remote)			Cool - Heat [Hi / Lo / S-Lo]	HxWxD	Liquid / Gas pipe
	kW	kW	dB[A]	mm / kg	Inch [mm]
CS-Z20TKEW	2.0	3.2	39 / 26 / 21 - 40 / 27 / 21	295 x 919 x 194 / 9	1/4 [6.35] / 3/8 [9.52]
CS-Z25TKEW	2.5	3.6	41 / 27 / 21 - 43 / 29 / 21	295 x 919 x 194 / 10	1/4 [6.35] / 3/8 [9.52]
CS-Z35TKEW	3.2	4.5 (4.4 only for CU-2E18SBE)	44 / 30 / 21 - 45 / 35 / 21	295 x 919 x 194 / 10	1/4 [6.35] / 3/8 [9.52]
CS-Z42TKEW	4.0	5.6 (5.0 only for CU-2E18SBE)	44 / 33 / 27 - 45 / 37 / 31	295 x 919 x 194 / 10	1/4 [6.35] / 3/8 [9.52]*1
CS-Z50TKEW	5.0	6.8 (5.3 only for CU-2E18SBE)	44 / 39 / 32 - 46 / 39 / 32	302 x 1120 x 236 / 12	1/4 [6.35] / 3/8 [9.52]*1
CS-Z71TKEW	7.0	8.7	49 / 40 / 32 - 49 / 40 / 32	302 x 1120 x 236 / 13	1/4 [6.35] / 1/2 [12.70]*2*3











4-way 60×60 Cassette	Cooling capacity	Heating capacity	Sound pressure	Dimension /	Net weight	Piping connections
Indoor / Panel (Wireless Remote)			Cool - Heat [Hi / Lo / S-Lo]	Indoor H x W x D	Panel H x W x D	Liquid / Gas pipe
	kW	kW	dB[A]	mm /	/ kg	Inch [mm]
CS-Z35UB4EAW / CZ-BT20EW	3.2	4.5 (4.4 only for CU-2E18SBE)	36 / 28 / 25 - 37 / 30 / 27	260 x 575 x 575 / 18	51 x 700 x 700 / 2,5	1/4 [6.35] / 3/8 [9.52]
CS-Z50UB4EAW / CZ-BT20EW	5.0	6.8 (5.3 only for CU-2E18SBE)	39 / 30 / 27 - 40 / 31 / 28	260 x 575 x 575 / 18	51 x 700 x 700 / 2,5	1/4 [6.35] / 3/8 [9.52]*1









Low Static Ducted	Cooling capacity	Heating capacity	Sound pressure	Dimension / Net weight	Piping connections
Indoor (Wired Remote)			Cool - Heat [Hi / Lo / S-Lo]	H x W x D	Liquid / Gas pipe
	kW	kW	dB[A]	mm / kg	Inch [mm]
CS-Z35UD3EAW	3.2	4.5 (4.4 only for CU-2E18SBE)	35 / 29 / 26 - 37 / 29 / 26	200 x 750 x 640 / 19	1/4 [6.35] / 3/8 [9.52]
CS-Z50UD3EAW	5.0	6.8 (5.3 only for CU-2E18SBE)	41 / 31 / 28 - 41 / 32 / 29	200 x 750 x 640 / 19	1/4 [6.35] / 3/8 [9.52]*1
CS-Z60UD3EAW	6.0	8.5	43 / 32 / 29 - 43 / 34 / 31	200 x 750 x 640 / 19	1/4 [6.35] / 1/2 [12.70]*2









CII-5E3/PRE



System Capacity (Min-	-Max Indoor Cooling Capacity Norma	al [Total Indoor Capacity Range]	3,2 to 7,5kW	4,5 to 11kW	4,5 to 17,5kW
Outdoor Unit			CU-2E18SBE	CU-4E23PBE	CU-5E34PBE
Cooling capacity	Nominal [Min - Max]	kW	5.20 [1.50-5.40]	6.80 [1.90-8.80]	10.00 [2.90-11.50]
EER	Nominal [Min - Max]	W/W	3.42 [6.00-3.42]	4.05 [5.59-3.56]	3.50 [5.27-2.98]
Input power cooling	Nominal [Min - Max]	kW	1.52 [0.25-1.58]	1.68 [0.34-2.47]	2.86 [0.55-3.86]
Heating capacity	Nominal [Min - Max]	kW	5.60 [1.10-7.20]	8.50 [3.00-10.60]	12.00 [3.40-14.50]
COP	Nominal [Min - Max]	W/W	4.63 [5.24-4.24]	4.47 [5.17-4.08]	4.20 [6.42-3.42]
Input power heating	Nominal [Min - Max]	kW	1.21 [0.21-1.70]	1.9 [0.58-2.60]	2.86 [0.53-4.24]
Current	Cool/Heat	А	7.10 / 5.35	7.50 / 8.80	13.20 / 13.40
Power source		V	230	230	230
Sound pressure	Cool/Heat (Hi)	dB(A)	49 / 51	48 / 49	53 / 54
Dimension	H×W×D	mm	619 x 824(+70) x 299	795 x 875(+95) x 320	999 x 940 x 340
Net Weight		kg	39	72	81
Piping connections	Liquid pipe	Inch (mm)	1/4 [6.35]	1/4 [6.35]	1/4 [6.35]
Tiping confidencials	Gas pipe	men (mm)	3/8 [9.52]	3/8 [9.52]	3/8 [9.52]
Max pipe length	(total room)	m	30	60	80
Pipe length range	(1 room)	m	3 - 20	3 - 25	3 - 25
Elevation difference	(in/out)	m	10	15	15
Pipe length for addition	onal gas	m	20	30	45
Additional gas amour	it	g/m	15	20	20
Refrigerant	[R410A]	kg	1.40	2.64	3.40
Operating range	Cool Min - Max	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46
operating range	Heat Min - Max	C	- 15 ~ +24	- 15 ~ +24	- 15 ~ +24

At least two indoor units must be connected.

Nominal cooling capacity / heating capacity are determined whereby the test to be performed with the system operating at a capacity ratio (of indoor units to outdoor unit) of 1, or as close as possible.

- *1 CZ-MA1P is to be used to reduce the connection size on the indoor unit from 1/2" to 3/8".
- *2 CZ-MA2P is to be used to increase the connection size on the outdoor unit from 3/8" to 1/2".
- *3 CZ-MA3P is to be used to reduce the connection size on the indoor unit from 5/8" to 1/2".





Sunlight Sensor technology can detect and reduce the waste of energy by optimising air conditioner operation according to room conditions. With just one touch of a button, you can save energy.



Inverter system

The Inverter range provides greater efficiency and comfort. Provides more precise temperature control, without highs and lows, and keeps the ambient temperature constant with lower energy consumption and a significant reduction in noise and vibration levels.



nanoe™

It promotes well-being by inhibiting growth of certain harmful viruses and bacteria, as well as deodorising your home.



△△△ Mild Dry cooling

Fine control helps prevent a rapid decrease in room humidity while maintaining the set temperature. Maintains an RH* up to 10 % higher than cooling operation (*RH: Relative Humidity). Ideal when sleeping with the air conditioner on.



More comfort with Aerowings. Direct airflow to the ceiling, creating a shower cooling effect with built-in twin flap.



Internet control

A next generation system providing user-friendly remote control of air conditioning units from everywhere, using a optional WLAM simple Android™ or iOS smartphone, tablet via the internet.

How do I combine indoor and outdoor units?

Each outdoor unit has a limit to the number of connecting indoor units, depending on capacity and the number of ports (rooms). To work out the connect combination, add the capacity index (kW) of each indoor unit you want to connect. The connect outdoor unit is the one that fits the total indoor capacity index within (and including) the minimum and maximum range. If there are several outdoor options to choose from, select higher or lower capacity outdoor depending on the simultaneous use you plan for your project.

Possible outdoor / indoor units combinations • R410A	Wall-mounted	4-way 60x60 Cassette	Low Static Ducted
Indoor unit capacity index	20 25 32 42 50 70	32 50	32 50 60
CU-2E18SBE // 3,2 - 7,5kW // 2 Rooms	✓ ✓ ✓ ✓*4 ✓*4	✓ ✓*4	✓ ✓*4
CU-4E23PBE // 4,5 - 11,0kW // 4 Rooms	✓ ✓ ✓ ✓*4 ✓*4	✓ ✓*4	√ √*4 √*4
CU-5E34PBE // 4,5 - 17,5kW // 5 Rooms	✓ ✓ ✓ ✓*4 ✓*4 ✓*4	✓ ✓*4	✓ ✓*4 ✓*4

^{*4} A CZ-MA1P pipe reducer is needed on the 42 and 50, a CZ-MA2P pipe expander is needed on the 60 and CZ-MA3P pipe reducer on the 70.

Outdoor Multi combination model		Model
CS-Z20TKEW	CU-2E18SBE / CU-4E23PBE /	-
CS-Z25TKEW	CU-5E34PBE	
CS-Z35TKEW / CS-Z35UB4EAW / CS-Z35UD3EAW		
CS-Z42TKEW	CU-2E18SBE / CU-4E23PBE /	CZ-MA1P
CS-Z50TKEW / CS-Z50UB4EAW / CS-Z50UD3EAW	CU-5E34PBE	
CS-Z60UD3EAW	CU-4E23PBE / CU-5E34PBE	CZ-MA2P
CS-Z71TKEW	CU-4E23PBE / CU-5E34PBE	CZ-MA2P / CZ-MA3P*5

^{*5} For CZ-MA3P necessary to use adaptor CZ-MA2P too.

*Annotations for nanoe™ on page 4

- *1 [Testing organisation] Panasonic Product Analysis Center [Testing Method] Verified using the six-level odour intensity scale method in an approximately 23m³ sized test room [Deodorisation method] nanoe™ released [Test substance] Surface-attached cigarette smoke odour [Test result] Odour intensity reduced by 1.2 levels in 2 hours [BAA33-130125-D01]
- *2 < Adhered bacteria (0157) > [Testing organisation] Japan Food Research Laboratories [Testing method] Measured the number of bacteria adhered to a cloth in an approximately 45L sized airtight test room [Inhibition method] nanoe™ released [Test substance] Adhered bacteria [Test result] Inhibited by at least 99.99% in 1 hour [208120880_001] <Adhered virus (Influenza virus H1N1 subtype)> [Testing organisation] Kitasato Research Center for Environmental Science [Testing method] Measured the number of virus adhered to a cloth in an approximately 1m3 sized airtight test room [Inhibition method] nanoe™ released [Test substance] Adhered virus [Test result] Inhibited by at least 99.9% in 2 hours [21 0084 1]
- *3 [Testing organisation] Japan Food Research Laboratories [Testing method] Measured the number of mould altered in an approximately 23m³ sized test room [Inhibition method] nanoe™ released [Test substance] Airborne mould [Test result] Inhibited by at least 99% in 1 hour [205061541-001]
- *4 <Dog-derived allergens and cat-derived allergens> [Testing organisation] Institute of Tokyo Environmental Allergens [Testing method] Direct exposure in a 45L airtight container and measured using the ELISA method [Inhibition method] nanoe™ released [Test substance] dog derived allergens, cat derived allergens [Test result] <Dog(dander)>Inhibited by at least 99% in 1 hour (11M-RPTAPR047_1) <Cat (dander) > Inhibited by at least 98% in 2 hours (11M-RPTAPR051_1)
- *5 < Pollen> Cedar [Testing organisation] Panasonic Product Analysis Center (Testing method) Measured allergen attached to a cloth, using the ELISA method, in an approximately 23m³ sized test room [Inhibition method] nanoe™ released [Test substance] Cedar pollen [Test result] Inhibited by at least 88% in 8 hours (BAA33-130304-F01)
- *6 [Testing organisation] Panasonic Product Analysis Center [Testing Method] Measured the amount of attached organic substances in an approximately 23m³ sized test room [Inhibition method] nanoe™ released [Test result] <Aromatic carboxylic acid (benzoic acid)> Broken down at least 99.9% in approximately 16 hours (Y13NF135)
- *7 [Testing organisation] Panasonic Product Analysis Center [Testing Method & test result] Approximately 34m³ sized test room, room temperature 23 degrees Celsius, humidity 30%, 8 women aged 30-49 with varying skin conditions ranging from being averagely moist to dry, the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corneum water content was measured before and after resting for 90 minutes being exposed to the stratum corner was made after resting for 90 minutes being exposed to the stratum corner was made after resting for 90 minutes being exposed to the stratum corner was made after resting for 90 minutes being exposed to the stratum corner was made after resting for 90 minutes and 100 minutes after the stratum corner was made after resting for 90 minutes after the stratum corner was made after resting for 90 minutes after the stratum corner was made after resting for 90 minutes after the stratum corner was made after resting for 90 minutes after the stratum corner was made aftera nanoe™ generating device, to find the average value of the change. [D01-071219F-01] [Testing organisation] Panasonic Product Analysis Center [Testing Method & test result] Approximately $46m^3$ sized test room, room temperature 25 degrees Celsius, humidity 40% Bundles (6 Bundles) of hair were suspended 2m from a nanoe 7m generating device, with repeated operation of the nanoe™ generating device: 8 hours on and 16 hours off. (D01-091005-01TM) [Method] nanoe™ released [Test substance] Hair